

ORGANIC SCAVENGER SXT Simplex Series

Installation Operation Maintenance Manual

Simplex Organic Scavenger With 5600 or 2510 SXT Series Downflow Brining Valve

Models

50 lit
100 lit
150 lit
200 lit
250 lit

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

CONTENTS

NOS.		PAGE
1.0	GENERAL NOTES	5
2.0	THE SCAVENGING PROCESS	6
2.1	In Service	6
2.2	Regeneration	6
2.3	The Regeneration Process	7
2.4	Meter Control of Regeneration Initiation	7
2.5	Time Clock Control of Regeneration Initiation	8
3.0	UNPACKING AND PARTS IDENTIFICATION	9
3.1	Basic Packages	9
3.2	Unpacking Notes	9
3.3	Missing or Damaged Goods	9
4.0	TEMPORARY STORAGE	9
5.0	DESCRIPTION OF PLANT COMPONENTS	10
5.1	Scavenger Vessel and Internals	10
5.2	Control Valve	10
5.3	Regeneration Controller and Transformer	10
5.4	Brine System	11
5.5	Blending System	11
6.0	PRE-INSTALLATION CHECKS	12
6.1	Mechanical	12
6.1.1	Foundations/Drainage	12
6.1.2	Operating Space	12
6.1.3	Incoming Water	12
6.1.4	Pipework	13
6.1.5	Water Supply Company Requirements	13
6.2	Electrical	13

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

NOS.		PAGE
7.0	ASSEMBLY/INSTALLATION	14
	7.1 Mechanical	14
	7.1.1 Simplex Models	14
	7.1.2 Charging the Resin	14
	7.1.4 Assembling the Control Valve	15
	7.1.5 Attatching the Control Valve	15
	7.1.6 Brine System	15
	7.1.7 Pipework	15
	7.1.8 Storage tank ball valve	15
	7.1.9 Drains and Overflow Connections	16
	7.2 Electrical	17
	7.2.1 Mains Supply	17
	7.2.2 Transformer	17
8.0	COMMISSIONING	18
	8.1 Introduction	18
	8.2 Controller Setting	18
	8.2.1 Setting the Time of Day	18
	8.2.2 Setting the Site Program	19
	8.3 Brine System	20
	8.3.1 Salt Tank Filling	20
	8.4 Pre Service Flush and Regeneration	21
	8.5 Blending System	21
	9.5 Temporary Shut-down	24
	9.6 Changes in Incoming Water	24
	9.7 Routine Monitoring	25

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

NOS.		PAGE
9.0	OPERATION	22
9.1	Normal Operation	22
9.2	Refilling with Salt	22
9.3	Manual Regeneration	22
9.4	By-passing the Scavenger	22
9.5	Temporary Shut-down	23
9.6	Changes in Incoming Water	23
9.7	Routine Monitoring	24
10.0	FAULT FINDING AND RECTIFICATION	25
10.1	No Flow to Service	25
10.2	Poor Treated Water Quality	25
10.3	No Regeneration	26
10.4	Unsatisfactory Capacity between Regeneration's	26
11.0	WARRANTY AND SERVICE	27
11.1	After Sale Warranty	27
12.0	TECHNICAL DATA	28
12.1	Process and Operating	29
12.2	Engineering Data	29
13.0	FACTORY PROGRAMMING	
13.1	Master Programming Setup Summary	30
13.2	Master Programming	31
13.4	Custom programming	33
13.4.2	Immediate Regeneration	33
14.0	DRAWINGS	
14.1	General Installation	34
15.0	CE CERTIFICATE	35
APPENDIX I		
	Valve manufacturer's manual including parts lists and exploded diagrams	

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

1.0 GENERAL NOTES

These instructions cover the 5600SXT & 2510SXT Range of Simplex Organic Scavengers, which includes models ranging in size from 50-250 litres resin volume.

It is recommended that these instructions are read throughout before commencing any work on the unit, particularly if you have no previous experience of installing and using a scavenger.

The installation of a scavenger is very straightforward, and the only adjustments to be made to the controller program are setting the time of day and water hardness as detailed in Section 8.2.2. However we have tried to make these instructions as comprehensive as possible to answer any queries you may have about the functioning of your scavenger.

This scavenger will require salt for regeneration. We recommend the used of proprietary 'pellet' or 'tablet' salt.

In the appendix to this manual is the original valve manufacturer's handbook. This is written for American customers and has a number of small differences in the setting up instructions from those used in Europe. In the event of confusion, refer to the data in this manual rather than in the valve manufacturer's handbook!

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

2.0 THE SCAVENGING PROCESS

Organic discolouration in water is caused by the presence of dissolved humic acids which are long chain complex organic molecules. In order to overcome the problems associated with these molecules, the humic must be removed. This process is called 'Scavenging'. One means of removing the organic molecules is to exchange them for soluble salts. This technique is known as 'Ion Exchange Scavenging'.

2.1 IN SERVICE

In order to scavenge the water, it is passed through a bed of Ion Exchange resin beads which are contained inside a vertical cylindrical vessel. these beads are made of a synthetic material, and are usually amber or dark brown in colour and between 0.5 and 1.0 mm in diameter.

As the water flows down through the resin, the humic acid molecules in the feed water are progressively exchanged for Chloride, with the result that the water which flows out of the unit contains Chloride ions instead of humic acids.

The Ion Exchange resin does not have an unlimited capacity for exchanging humic acids, so to keep the exit water fully treated it is necessary to periodically 'Regenerate' the resin to restore its capacity to scavenge the water.

2.2 REGENERATION

The scavenging process can be reversed if a strong solution of Sodium Chloride (i.e. Common salt dissolved in water -'brine') is passed through the resin.

The high concentration of Chloride allows it to exchange for the humic acids held on the resin, and these are then carried away to drain. The resin is left full of Chloride to enable it to soften water again. Depending on the type of humic acid removed, it may also be necessary to periodically regenerate the unit with Caustic Brine where a small amount of Caustic Soda added to the brine to assist in removing organic molecules from the surface of the resin.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

2.3 THE REGENERATION PROCESS

The regeneration process consists of four stages:-

Backwash - Water flows upwards through the resin bed, and out to a drain. As it does so, it loosens the ion exchange beads, removes any resin 'fines' (i.e. small pieces of broken beads etc.) and cleans off any particles of dirt or pipework corrosion products which may have accumulated during the service cycle.

Brine injection/Displacement Rinse - During the first part of this stage, the concentrated salt -solution is drawn from the salt storage tank, blended with water to reduce the concentration to the correct level, and passed up through the resin. When the required quantity of brine has been drawn in, the water flows alone to push the remaining brine through the resin at the correct rate, and ensure that all the resin sees the right amount of regenerant.

Fast Rinse - This follows the brine draw/displacement rinse, and entails rinsing away the residual brine and humic acids from the resin and re-packing the resin bed down. This is done down with water flowing through the resin in the direction of service.

Salt Tank Refill - Following the fast rinse, a quantity of water sufficient to dissolve the correct amount of salt for the next regeneration is returned to the salt tank. When this has finished, the unit automatically returns to service.

2.4 METER CONTROL OF REGENERATION INITIATION

A water meter is installed in the outlet from the scavenger, to measure the volume of water which passes to service. This meter drives a turbine, the movement of which is measured by a magnetic sensor which sends signals to the regeneration controller. The controller microprocessor uses this information to calculate when the unit should be regenerated. Every night, at 2 am (for example), the volume of water used in the preceding days is compared to the capacity of the scavenger. The computer then assesses if the resin has enough capacity left to supply the next day's use, and if not, starts the regeneration.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

2.5 TIME CLOCK CONTROL OF REGENERATION INITIATION

Time clock configuration valves initiate regeneration at a pre-set time after a pre-set number of days. Both the time of day for regeneration and the frequency of regeneration are adjustable.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

3.0 UNPACKING AND PARTS IDENTIFICATION

3.1 BASIC PACKAGES

The scavenger will be delivered in a number of packages which include a glassfibre reinforced pressure vessel, a control valve, a brine tanks, two or more 25 litre bags of resin and a funnel to fill the vessel

3.2 UNPACKING NOTES

The unpacking of the scavenger is quite straightforward, and there are no 'hidden' items. It is advisable to keep the packages sealed until such time as they are used, to prevent dust or water entry.

Care should be taken in lifting the scavenger or its parts out of their cartons. It is advisable to lay large cartons on their side and slide out the scavenger or parts prior to standing them up.

3.3 MISSING OR DAMAGED GOODS

Immediately on receipt of the goods, it is advisable to check that all items ordered have been received. If you have any doubt that goods have been supplied as requested, please contact your supplier immediately. If any items are missing or damaged, the carrier and your supplier must be notified in writing within 3 days of receipt if a claim is to be made.

4.0 TEMPORARY STORAGE

If installation is not to start immediately after delivery, the equipment should be stored in a clean dry area, where it will not be damaged, or be subjected to temperatures below freezing.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

5.0 DESCRIPTION OF PLANT COMPONENTS

5.1 SCAVENGER VESSEL AND INTERNALS

The pressure vessel which contains the ion exchange resin is made from a fibreglass/epoxy resin outer layer surrounding an inner, seamless shell made from Polyethylene. The vessel has a threaded hole at the top, of 2.5 inch nominal diameter, into which the control valve fits.

All vessels are equipped with a single filter distribution system. This is attached to a central riser tube, which is connected to the control valve, and passes water into and out of the resin bed.

5.2 CONTROL VALVE

The control valve is mounted on top of the vessel, and directs the water flow in and out of the resin bed during the service and regeneration cycles. The body of the control valve is made from glass reinforced Noryl.

The valve carries out its various functions by rotating a cam that drives a piston through a series of seals and ports. Depending on the position of the piston in the seal stack, the different functions of the valve will take place

5.3 REGENERATION CONTROLLER AND TRANSFORMER

The regeneration controller is attached to the valve, and is contained in a plastic housing.

The controller is powered by 24v AC electricity, and a separate, wall mounted transformer is connected to the valve to reduce normal mains voltage down from 240v so that all the electrical supply in and around the control valve runs at a safe 24v.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

5.4 BRINE SYSTEM

The brine system consists of a moulded polyethylene tank into which the brine well and brine pick up are assembled. The tank forms the salt storage container.

The brine pick-up tube is connected to the pipe from the control valve which sucks the brine from the tank. At the bottom of the brine pick-up tube is an air check valve. This serves to prevent air entering the valve when all the brine has been drawn in. Air in the system could cause spurting and 'hammering' at the taps or outlets.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

6.0 PRE-INSTALLATION

6.1 MECHANICAL

6.1.1 Foundation/Drainage

The scavenger will not require any special foundations, provided that a firm, level area which is capable of supporting the working weight is available. (See Engineering Data, Section 12.2)

Unwanted water from the regeneration process must flow to drain, and so an open drain or gully, capable of passing the necessary flow is required (see Process and Operating Data, 12.1, for relevant flows). The total flow of water to drain depends on site conditions, but will be approximately 6 times the resin volume. The drain may be at a level no higher than 500mm above the scavenger valve.

A second drain is required for the brine tank overflow. This is a safety drain which will only discharge water if there is a malfunction in the control valve. Where possible this should be installed through an outside wall like a cistern overflow, where it will give a visual indication of any failure.

6.1.2 Operating Space

The space occupied by the scavenger can be found in the Engineering Data (Section 12.2).

Access will be required to refill the brine tank, and to carry out adjustments or maintenance on the equipment. It is therefore recommended that a minimum of 500mm clearance be allowed in front of the unit for this purpose.

6.1.3 Incoming Water

The raw water to be fed to the scavenger must comply with the following:-

1. Available at all times at a flow equal to the required service flow or greater, and
2. At a pressure between 1.7 and 5.5 bar
3. Temperature between 0 and 50°C
4. Suspended solids less than 1 ppm
5. Iron less than 0.2 ppm, Manganese less than 0.1 ppm, Free Chlorine less than 1 ppm if temperature is less than 15°C, less than 0.3 ppm if temperature higher (up to 30°C)

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

6.1.4 Pipework

Pipework to be connected to the scavenger should not have an excessive amount of hardness scale deposit. Piping that is heavily built up with scale (or Iron deposits) should be replaced.

Make sure that the pipework can be connected to the scavenger in such a way as to impose no stresses on the control valve, and that it is properly aligned and supported.

A system for the complete by-passing and isolation of the scavenger should be installed (see Section 7.1.6).

6.1.5 Water Supply Company Requirements

It is essential that if the equipment is to be connected directly to a mains water supply, the local bylaws must be adhered to. These cover both plumbing and the prevention of backflow into the mains. If there is any doubt, the local water inspector should be consulted, but in general, the installation of a 'Double check valve assembly' conforming to BS6282 part 2 will be required in the feed pipework to the scavenger.

If the pressure available from the mains is not adequate it will be necessary to install a booster pump arrangement. Such a system would be covered by additional bylaws, and the water storage tank needed must comply with these.

6.2 ELECTRICAL

A continuous supply of 24v, 5 VA is required by the scavenger. A 240v transformer with an output of 9.6 VA is provided, which should be connected to an uninterrupted mains supply, which is separately 1 Amp fused, and does not have any additional switch.

It is recommended that the transformer be attached to a nearby wall, within 500 mm of the scavenger in an area free from water spray or excessive heat or condensation.

A plug is not provided with this scavenger since the cable should be connected to fused spur outlet. However if that is not possible then a plug should be fitted to the cable with a 1 amp fuse. The socket used should be un-switched to prevent the scavenger from being inadvertently turned off.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

7.0 ASSEMBLY/INSTALLATION

7.1 MECHANICAL

Check all the items against the parts list and shipping documents, and ensure you have them all before starting work. In addition to the scavenger you will require installation materials and basic tools, (i.e., spanners, screwdrivers etc., and PTFE tape)

7.1.1 Simplex Models

Assembling Vessel, Riser Tube and Internals

Simplex units are shipped as pre-assembled components to reduce the risk of transit damage. These need to be assembled on site. Open the carton containing the pressure vessel and remove it. Check that the vessel has not been damaged in transit. Pay particular attention to the vessel top hole threads, as this is where the valve will seal. Check that there is no dirt or swarf inside.

Riser Tube/Bottom Filter

This comprises a length of pipe (the 'riser tube') to one end of which is glued a moulded screen. The other end is fitted into the bottom of the control valve. To make sure the riser fits properly, and there is no leakage, it will be supplied to the correct length prior to despatch.

7.1.2 Charging the Resin

The ion exchange resin is supplied in 25 litre bags plus a part bag if applicable. All models will be supplied with exactly the right quantity of resin. Two different, but fully compatible resins are used to optimise the efficiency of the resin with a wide range of organic loadings in the raw water. It is important that only the correct volume of resin is put into the vessel or the system will not function properly. (See **Section 12.1.2** for data)

Place the vessel in its final location - once filled with resin and water they should not be moved. Fill the vessel about 1/5 full with clean water. The riser is 45 mm shorter than the internal height of the vessel so in order to keep it centrally located and prevent resin falling inside the riser, and 'extender/cover' is provided to be slipped over the end of the riser when filling with resin. This must be carefully removed without disturbing the riser prior to fitting the control valve. Carefully open the resin bags and pour the resin into the vessel, using the funnel provided, keeping the riser tube central and upright. Take great care

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

not to spill resin on the floor. If any is spilt, make sure it is swept up immediately, as it is very easy to slip on it. Wash away any loose resin from the threads of the vessel or adapter collar. Remove the riser extender cover and check that the top of the riser is still correctly located

7.1.4 Assembling the Control Valve

Carefully remove the control valve from its packing, and check that all parts are present. Fit the top filter/distributor to the valve. This is a 'snap' bayonet fit.

7.1.5 Attaching the Control Valve

Carefully fit the control valve on to the vessel, taking care to ensure that the riser tube locates correctly into the valve base through the top distributor, and that the threads are not crossed. Also take care to make sure that the 'O'rings are properly seated and not pinched.

7.1.6. Brine System

Move brine tank into position and connect the outer port of the bulk head union to the brine draw connection on the valve using the 3/8" tubing. Make sure that this connection is also tight to stop air leaking in.

If brine draw tubing is adjusted for length during installation, ensure that brass tubing inserts are refitted into tubing end prior to connecting into brine tank and control valve.

7.1.7 Pipework

Pipework should be assembled incorporating the features shown in the Installation Diagram, Section 14.1. It is essential that inlet and outlet isolating valves and a by-pass valve are provided, and that the water main is protected by a double check valve where appropriate (see Local Water Bye-laws).

In domestic premises it is recommended that a hard water supply is still used for drinking water (see General Notes Section 1.0).

Pipework can be constructed from any normally acceptable material (Copper, Galvanised, Plastic), provided it is properly supported and aligned. Ensure that the pipe is sufficiently large to accommodate the flow of water required, making due allowance for the pressure drop between the scavenger and the point of discharge of soft water.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

NOTE: IF BRAZED OR SOLDERED FITTINGS ARE TO BE USED, THE PIPEWORK MUST BE DISCONNECTED FROM THE VALVE DURING HEATING AND COOLING. EXCESS HEAT CAN CAUSE PERMANENT DAMAGE TO SOME OF THE VALVE COMPONENTS.

The inlet and outlet pipework should be connected to the horizontal, rear facing connections on the rear of the valve manifold (1" BSP Female) (see Fig 1 in Section 14.1).

7.1.8 Storage tank ball valve

Conventional ball float valves pass water at a slow trickle into storage tanks and cisterns when they are shutting off. Trickle flow is not recommended for satisfactory functioning of a scavenger since channelling can occur through the resin bed and the meter may not accurately monitor very low flows. It is therefore recommended that main storage tanks for softened water should have the ball valve replaced with a servo type valve such as a Torbeck or Fluidmaster which permit full flow until they close off. These are inexpensive and are a direct replacement for the more common brass ball float valves.

7.1.9 Drains and overflow connections

Connect the overflow fitting on the brine tank to a suitable drain, using flexible or rigid tubing. Make sure that there is a clear gap of approximately 50 mm between the end of the tube and the top of the drain tundish or gully edge.

The drain connection from the valve is a 1/2" hose spigot. Flexible tube should be run from this spigot to a drain capable of taking the maximum flow in regeneration (see Section 12.1), and leaving a similar gap above the drain edge. The drain must not be higher level than the 500mm above the control valve and preferably should have an air break at the same height as the control valve. A standard washing machine upstand is quite suitable for this.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

7.2 ELECTRICAL

Electrical installation is very straightforward, but should still be carried out by a competent electrician, and must conform to the appropriate standards of safety.

7.2.1 Mains Supply

The mains supply should be through a separate, switched supply, fused and earthed in accordance with Institute of Electrical Engineers Regulations. Current rating should be 1 Amp.

7.2.2 Transformer

A safety transformer is provided to reduce the voltage to 24 Volts to operate the controls.

This should be attached to a convenient wall, within 500mm of the scavenger. **DO NOT SWITCH ON THE ELECTRICAL SUPPLY AT THIS STAGE** See Fig 3 in Section 14.2

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

8.0 COMMISSIONING



8.1 INTRODUCTION



It is recommended that the commissioning of the plant is undertaken by a trained service engineer, who will be able to put the plant into service quickly, and most efficiently. However, if the services of an experienced engineer are not available, following the steps outlined below will result in the system being properly commissioned.

8.2 CONTROLLER SETTING - Site programming mode

All controller settings will require the valve to have a mains supply switched on. The valve must not be regenerating when controller settings are adjusted.

8.2.1 Setting the Time of Day

Meter controlled valves: The display alternates between the time of day on the left and the remaining calculated capacity in litres on the right. Wait until the time of day is displayed and the press the up  and down  arrow keys until the correct time of day is displayed.

Time clock only valve: The time of day is permanently displayed. Press the up  and down  arrow keys until the correct time of day is displayed.

8.2.2 Site programming - Setting the capacity, time of day of regeneration and regeneration override.



The scavenger regeneration cycles have been factory programmed. Unless very a high flows continuous flow of water are expected, scavenger are normally programmed to regenerate by a time clock setting.

The time of day set for regeneration to take place has been entered as 2:00 AM and this may need to be altered depending on site requirements.

On metered scavengers, the regeneration override is used to freshen the resin if a regeneration has not taken place for a number of days. On time clock scavengers the override is used to set the frequency of regeneration.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

Press and hold the press the up  and down  arrow keys together for 5 seconds. On metered scavengers only the volume capacity of the resin in litres will be displayed. This can be adjusted to suit site conditions by pressing the up and down arrows.

Press the extra cycle button to set the time of day of regeneration. The default is set to 2:00 am. This may be changed to any other convenient time by pressing the up and down arrows.

Press the extra cycle button to set the regeneration override. The default is 7 days for metered scavengers and every 3 days for time clock scavengers. This may be changed to a different interval by pressing the up and down arrows.

Press the extra cycle button to exit the Site Programming mode.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

8.3 BRINE SYSTEM

8.3.1 Salt Tank Filling

Place approximately 100 mm depth of water in the bottom of the cabinet. Fill with pellet salt (recommended) until the cabinet it is full or with granular salt until it is 3/4 full.

Overfilling the cabinet with granular salt can result in an overflow of brine. This cannot happen with pellet salt which is why it is recommended.

Under no circumstances use cooking salt or Pure Vacuum Dried (PVD) salt to fill the cabinet as either of these will damage the resin and the internal components of the regeneration valve and brine draw system.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

8.4 PRE-SERVICE FLUSH AND REGENERATION

Set the manual isolating valves so that water will by-pass the scavenger. Turn on the main water supply. Open a treated water tap close by and let the water run for a few minutes to flush out any debris or foreign matter from the pipework system.

Turn on the power supply to the valve.

Press the extra cycle button for five seconds. The display will then indicate 1-----. Wait for the controller to advance the valve until a time in minutes appears on the right of the display.

Slowly open the mains inlet isolating valve until water starts to flow slowly from the drain line. Air will escape initially through the drain line. When water begins to flow steadily, open the valve fully.

Press the 'Extra Cycle' button four times more to return the valve to service. After each press, wait for a time to appear on the right of the display. There will be loud 'click' as the brine valve closes while the valve advances from position 2 to position 3, and from position 4 to the home position.

Finally press the 'Extra Cycle' button to initiate a complete regeneration and refill the brine tank to the correct level. Do not advance any of the cycles.

During regeneration the scavenger will pass hard water to service. The bypass can therefore be closed and the outlet valve opened. When the scavenger returns to service then soft water will be available.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

9.0 OPERATION

9.1 NORMAL OPERATION

Operation is completely automatic, with regeneration being initiated whenever required by the valve controller.

9.2 REFILLING WITH SALT

Since salt is used in the regeneration process, the level of salt in the brine tank will fall after each regeneration. It should not be allowed to fall below 75 mm above the bottom of the cabinet. When the low level is approached (or more often, as a routine) the cabinet should be refilled to the top with pellet salt or 3/4 filled with granular salt.

The approximate capacity of the cabinet for salt is shown in Section 12.1.

9.3 MANUAL REGENERATION

There can be occasions during the life of equipment such as scavengers when the original design basis is not applicable. For example, after a shutdown period, the demand for scavenged water may far exceed the design flow rate for a short period. Another possibility is that the Water Service Plc finds it necessary to change to a supply which has higher organics levels than that normally received. It will then be necessary to give the unit an additional regeneration to ensure that treated water continues to be available to service.

This additional regeneration is initiated manually.

Press and hold in the 'Extra Cycle' button for five seconds until the number 1----- appears in the display. Regeneration will proceed automatically immediately.

If the 'Extra Cycle' button is only pressed briefly, the 'Service' indicator will begin to flash immediately and a regeneration will occur at the normal regeneration time (2:00 am set as default).

9.4 BY-PASSING THE SCAVENGER

There may be occasions when it is desirable to by-pass the scavenger, to allow hard water to go to service, or if the scavenger is for some reason not performing properly.

To do this, open the by-pass isolating valve and close the scavenger outlet isolating valve (see Installation Diagram, Fig 3 in Section 14.2).

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

The scavenger can still be safely regenerated with the valves in this position. If for any reason, it is desired to completely isolate the scavenger, it will be necessary to close the inlet isolating valve as well.

9.5 TEMPORARY SHUT-DOWN

The scavenger can be left indefinitely without use. During periods of low or minimal water use, for example during vacation absences, the valve controller will automatically regenerate the resin at the frequency set in the regeneration override.

If the scavenger needs to be taken out of service for some time for any other reason, it is recommended that one or two simple procedures be undertaken to ensure the return to operation is as smooth as possible.

1. The unit should be left regenerated.
2. The electrical supply should be turned off
3. The inlet and outlet manual isolating valves should be closed.
4. The valve should be drained of water if there is the possibility of the system freezing.

On restart, it will be necessary to reset the 'time of day. It is also recommended that the unit be regenerated again before being put into service.

9.6 CHANGES IN INCOMING WATER

There is a much greater tendency these days for the Water supply Plc to use water from more than one source. It is unlikely that two sources will have similar chemical composition, and so when this happens the raw water being fed to the unit may also change. It is suggested that routine monitoring be undertaken to check whether this is the case (see 9.9). If variation greater than 5% is found, it will be necessary to check whether the settings for regeneration need changing. Resetting is the same as setting.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

9.7 ROUTINE MONITORING

The following recommendations are made to help the user of the scavenger confirm that it is performing as required, and to give early warning of possible problems. The operation of the scavenger is completely automatic, and should not require adjustment (except as above).

Weekly

Check the treated water quality.
Inspect the level of salt in the salt tank and refill if necessary.

Monthly

Check raw water quality, and record. Compare with original quality data and adjust volume capacity setting if required (see Section 13.1).

Annually

Inspect and clean/replace as necessary the brine injector, piston and the internal seals. This should be performed by a competent engineer familiar with Fleck valves.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

10.0 FAULT FINDING AND RECTIFICATION

Modern water scavengers are extremely reliable and unlikely to give any problems if they are installed and operated correctly.

10.1 NO FLOW TO SERVICE

Check mains pressure is above 1.7 bar.

Check inlet and outlet isolating valves are open.

Check service outlet valve is open.

Check pressure drop across resin. If excessive, resin may be fouled, or internals blocked. Initiate a caustic regeneration. If this does not free up the resin the scavenger will need to be inspected and serviced by a competent engineer.

10.2 POOR TREATED WATER QUALITY

Check manual by-pass closed.

Check blending valve has not been opened or adjusted.

Check salt level in salt tank. Refill if necessary.

Trickle flow through conventional ball valve in storage tank. Replace with Torbeck or Fluidmaster servo valve.

Check raw water pressure above minimum. If flow is less than minimum, channelling of water can occur in resin. which results in inadequate treatment.

Check injector strainer and injector not blocked (see Appendix for drawings). Clean if necessary.

Check brine pick-up screen not blocked. Clean if necessary.

Check brine line not split. Replace if necessary.

Check raw water quality, and then check if controller setting is correct for this quality.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

10.3 NO REGENERATION

Check electrical supply, fuses etc. satisfactory.

Check control head motor runs, by initiating a manual regeneration, and listening for drive motor gently 'ticking' as it advances between cycles. Replace if necessary.

Check meter running freely (if fitted) indicated by running a treated water outlet and watching the flow indicator and 'volume remaining' reading on the display count down at the same rate as the water flow.

10.4 UNSATISFACTORY CAPACITY BETWEEN REGENERATIONS

See Section 10.2.

Check condition of resin. It may have become fouled, inhibiting the regeneration process. If fouled, it should be cleaned or replaced.

Check incoming water for presence of Chlorine. If high, the resin may have been degraded.

Check raw water pressure. Too high pressure may mean the brine draw stage of regeneration is not effective

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

11.0 WARRANTY AND SERVICE

11.1 AFTER SALE WARRANTY

Your scavenger is covered by a parts warranty for a period of one year from installation.

Should you have any problems with your scavenger or require routine service, please contact your supplier.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

12.1 PROCESS AND OPERATING DATA

12.1.1 5600SXT and 2510SXT Series Water Scavengers 50-250 litre

MODEL		50 L	100 L	150 L	200 L	250 L
PARAMETER	UNITS					
Max. Service Flow	M3/hr	0.78	1.56	2.34	3.12	3.9
Min Service Flow	M3/hr	0.25	0.5	0.75	0.8	1.0
Salt used per regeneration	kg	12	24	36	48	60
Regeneration Time	mins	82	80	112	128	134
Resin Volume	litres	50	100	150	200	250
Salt Storage Capacity	kg	120	240	340	440	700
No of Regens Salt stored	-	10	10	9	9	11
Maximum Flow to drain	Lit/min	9	19	26	38	38

IMPORTANT NOTES

Much of the data quoted in the above table is affected by the inlet pressure, and so should be regarded as nominal only.

Total flow to drain will be similarly affected and is therefore not quoted, but will be about 6 times the resin volume.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

12.2 ENGINEERING DATA

12.2.1 5600SXT and 2510SXT Series Water Scavengers 50-100 litre

MODEL		50 L	100 L	150 L	200 L	250 L
PARAMETER	UNITS					
Diameter of vessel/valve	mm	254	356	407	534	534
Height to top of valve	mm	1590	1984	1988	2038	2038
Diameter of brine tank	mm	480	700	840	880	960
Height of brine tank	mm	1040	950	900	1100	1250
Inlet Conn.	ins BSPF	1.0	1.0	1.0	1.0	1.0
Outlet Conn.	ins BSPF	1.0	1.0	1.0	1.0	1.0
Drain Conn.	ins	1/2	1/2	1/2	1/2	1/2
Brine Tank Overflow Conn.	ins	3/4	3/4	3/4	3/4	3/4
Delivered Wt.	Kg.	58	115	170	210	280
Electrical Power	v	240	240	240		
	Hz	50	50	50		
	V/A	1.2	1.2	1.2		

MAXIMUM OPERATING PRESSURE 5.5 Bar MINIMUM OPERATING
PRESSURE 1.7 Bar MAXIMUM OPERATING TEMPERATURE 50.0C
HEADROOM - Allow 100 mm greater than overall height.

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

13.0 Factory Programming

13.1 Master Program Settings

Master Program set up summary

To enter programming, set time of day to 12:01 then push and hold the up and down buttons together for 5 seconds.

Parameter description	Disp	Value	Res Vol	50	100	150	200	250
Display Format	DF	Ltr						
Valve Type	VT	dF1b						
Control Type	CT	tc						
Number of Tanks	NT	1						
Day Override	DO	7						
Regeneration Time	RT	2:00						
BackWash	BW	see across	⇒	6	8	8	10	10
Brine Draw/Slow Rinse	BD	see across	⇒	60	80	80	100	100
Fast Rinse	RR	see across	⇒	6	8	8	10	10
Brine Refill *	BF	see across	⇒	10	10	\$12	14	14
Exit to time of day								

***=1.00 gpm BLFC**

5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

13.2 Custom Programming

Variations on the settings may be required. Adjustments will need to be made through the Master Programming Mode.

13.2.1 Immediate regeneration. The valve is factory programmed for delayed regeneration which means that it will check whether it has zeroed out at the pre-programmed regeneration time (factory set to 2:00 AM).

However the valve can also be set for 'immediate' regeneration when it will regenerate as soon as the water meter zeroes out at any time of the day. The setting is made in step 2 of the Master Programming mode when the setting should be changed to 7--2. (see section 13.2)

No reserve needs to be allows for the system capacity when the scavenger is programmed for immediate regeneration.

Please note, that there will then be no 'regeneration time of day' option presented during the Master or Site Programming modes when immediate regeneration is selected.


5600/2510SXT Simplex Organic Scavenger

Installation Operation Maintenance Manual

14.0 Drawings

14.1 Installation Layout

Fig 1 General Installation Layout 5600SXT Simplex Scavengers

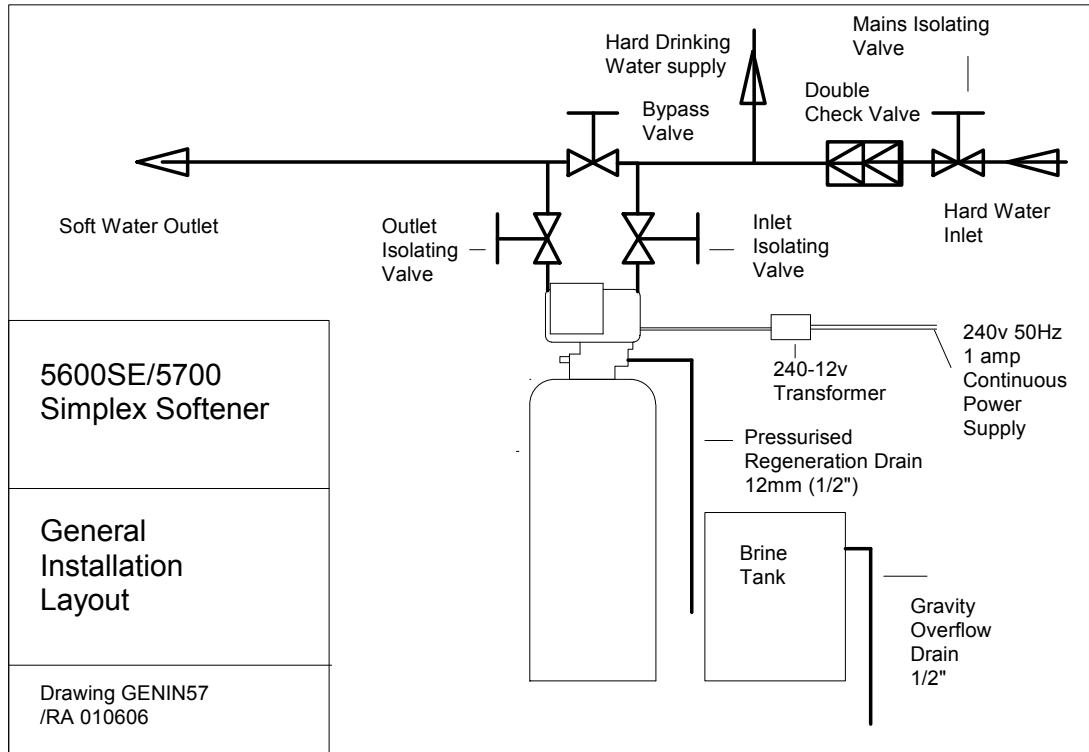

5600/2510SXT Simplex Organic
Scavenger
Installation Operation Maintenance Manual

Manufacturer's Declaration of Conformity

We the undersigned

EURAQUA UK, HITCHIN, ENGLAND

Certify that the product

*type: **SIMPLEX ORGANIC SCAVENGER WITH FLECK 5600SXT AND
2510SXT 24 VOLT AC VALVE***

*has been designed and manufactured in accordance with the
specifications of the following:*

Directive

Machinery Directive 89/392/EEC
Low Voltage Directive 73/23/EEC
EMC-Directive 89/336/EEC

Standard

EN 292-1, EN 292-2
EN 60 335-1
EN 55 014



RT Adam
Director

Hitchin, England 01/01/06
Issue place & date